



MD 1609 Coil Assembly.

The component supplier will deliver a complete coil kit.

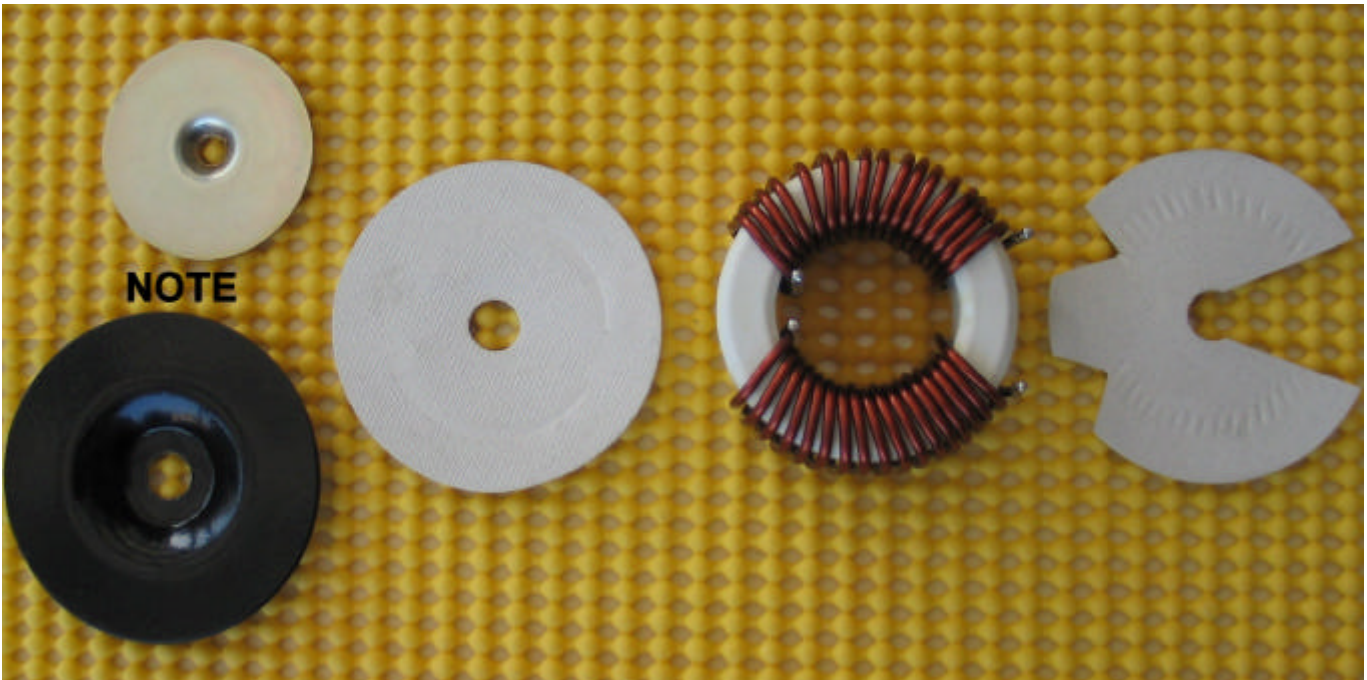

NOTE:
Depending on the component supplier the design of the metal disc may vary.

For best isolation resistance, the non-insulated copper on the coil shall not have contact to the Neopren washer on final assembly on PCB.

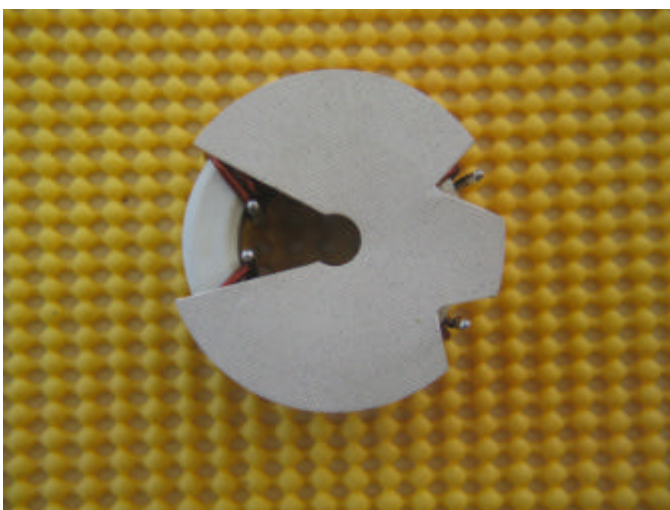

NOTE:
Depending on the component supplier the Neopren washer can be delivered with out cut outs. In this case the EMS shall prepare the Neopren washer before assembly of the coil.